

D GB

COSMO
GUTES KLIMA
BESSER LEBEN


COSMO
GUTES KLIMA
BESSER LEBEN


COSMO GMBH
Brandstücken 31 · 22549 Hamburg

Info@cosmo-info.de
www.cosmo-info.de

CBWMS25

MONTAGE- UND BETRIEBSANLEITUNG
EIN MISCHVENTIL FÜR WARMWASSERBEREITUNG UND HEIZSYSTEME
INSTRUCTIONS FOR USE
A MIXING VALVE FOR WATER HEATING AND HEATING SYSTEMS

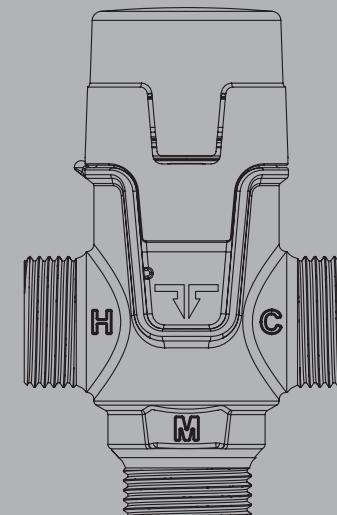

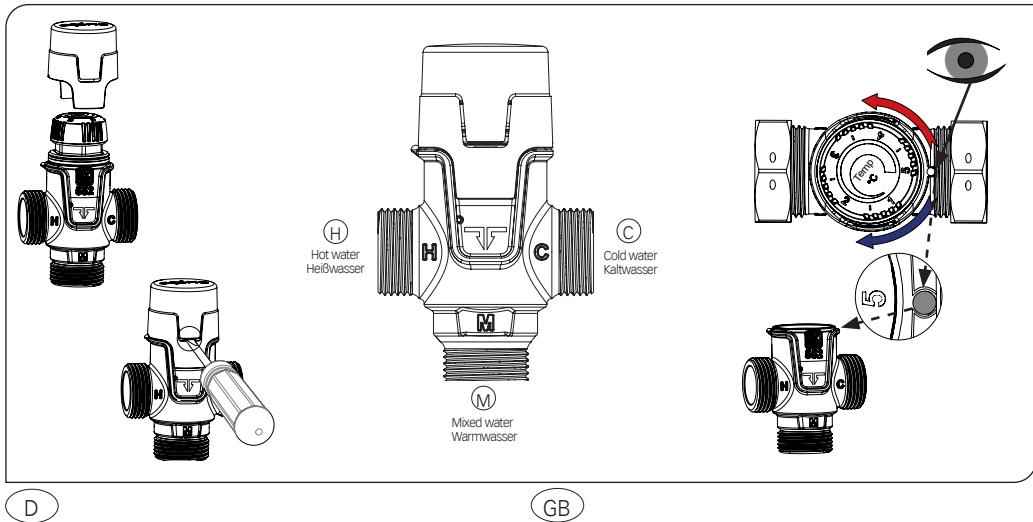


D

Die Installation muss in Übereinstimmung mit den geltenden Installationsregeln, Gesetzen und Vorschriften durchgeführt werden. Vor Inbetriebnahme der Anlage muss die Wassertemperatur kontrolliert werden um das Risiko von Legionellenwachstum und Verbrennungen zu verhindern. Das Ventil darf niemals unter Druck demontiert werden.

GB

The installation must be performed in accordance with applicable installation rules, laws and regulations. Before operating the system, the tap water temperature must be checked to prevent risks of legionella growth and burns. Never dismantle the valve under pressure.

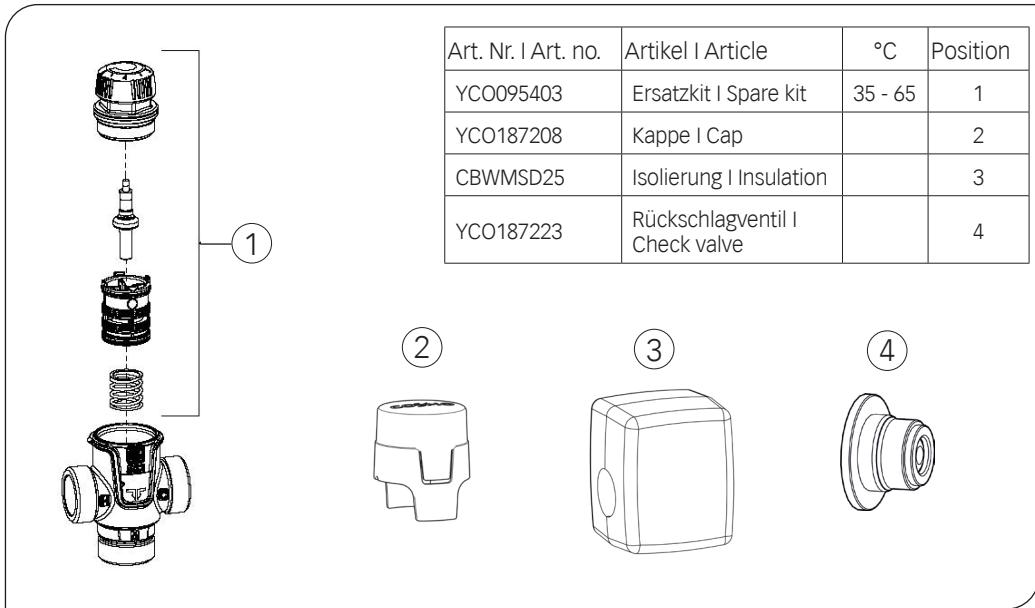

Art. Nr. / Art. no.	Artikel / Article	°C	Position
YCO095403	Ersatzkit / Spare kit	35 - 65	1
YCO187208	Kappe / Cap		2
CBWMSD25	Isolierung / Insulation		3
YCO187223	Rückschlagventil / Check valve		4

